


Class 6000 Socket Weld

Fig. 2178 Laterals


Fig. 2174 Couplings

Figure 2178
Laterals



Size		B		C		D		K		L		Unit Weight	
NPS	DN	in	mm	in	mm	in	mm	in	mm	in	mm	lbs	kg
1/2	15	1.56	39.62	0.855	21.72	0.375	8.89	2.56	65.10	3.56	90.50	2.00	0.91
3/4	20	1.84	46.74	1.065	27.05	0.500	12.70	3.00	76.20	4.13	104.78	3.06	1.39
1	25	2.22	56.39	1.330	33.78	0.500	12.70	3.50	88.90	4.81	122.17	5.13	2.33
1 1/4	32	2.50	63.50	1.675	41.91	0.500	12.70	3.94	100.08	5.38	135.89	6.25	2.84
1 1/2	40	3.03	76.96	1.915	49.53	0.500	12.70	4.75	120.65	6.44	163.58	11.94	5.43

Figure 2174
Couplings




Size		B Socket Dia.		C Minimum		D Bore Dia.		E		J Socket Depth Minimum		Unit Weight	
NPS	DN	in	mm	in	mm	in	mm	in	mm	in	mm	lbs	kg
1/2	15	.875 .855	22.2 21.8	0.204	5.18	.494 .434	12.5 11.0	0.38	9.5	0.38	9.5	0.53	0.24
3/4	20	1.085 1.065	27.6 27.2	0.238	6.04	.642 .582	16.3 14.8	0.38	9.5	0.50	12.5	0.56	0.25
1	25	1.350 1.330	34.3 33.9	0.273	6.93	.845 .785	21.5 19.9	0.50	12.5	0.50	12.5	0.92	0.42
1 1/4	32	1.695 1.675	43.1 42.7	0.273	6.93	1.190 1.130	30.2 28.7	0.50	12.5	0.50	12.5	1.16	0.53
1 1/2	40	1.935 1.915	49.2 48.8	0.307	7.80	1.368 1.308	34.7 33.2	0.50	12.5	0.50	12.5	2.57	1.17
2	50	2.426 2.406	61.7 61.2	0.374	9.50	1.717 1.657	43.6 42.1	0.75	19.0	0.62	16.0	4.75	2.15
2 1/2	65	2.931 2.906	74.4 73.9	0.410	10.41	2.185 2.065	55.5 52.5	0.75	19.0	0.62	16.0	-	-
3	80	3.560 3.535	90.3 89.8	0.480	12.19	2.684 2.564	68.2 65.1	0.75	19.0	0.62	16.0	-	-
4	100	4.570 4.545	115.7 115.2	0.580	14.73	3.498 3.378	88.8 85.8	0.75	19.0	0.75	19.0	-	-

Note: When the pipe is seated against the bottom of the socket prior to welding, to prevent possible cracking of the fillet welds, it is recommended that the pipe be withdrawn approximately 1/16 in (1.6mm) away from contact with the bottom of the socket before starting the weld.
Average of socket wall thickness around periphery shall be no less than listed values. The minimum values are permitted in localized areas.

PROJECT INFORMATION	APPROVAL STAMP
Project:	Approved
Address:	Approved as noted
Contractor:	Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

Fig. 2178 Laterals
Fig. 2174 Couplings

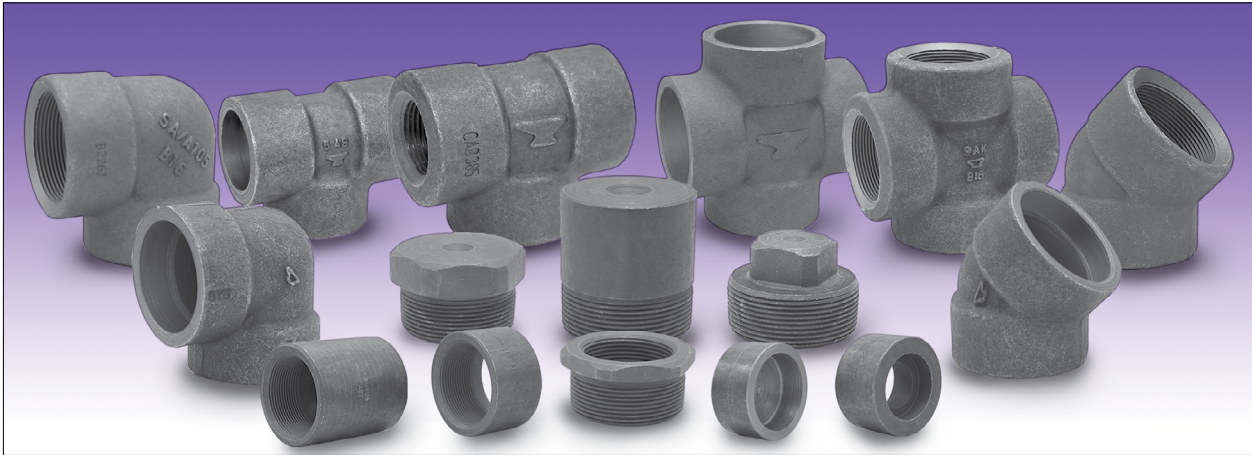

Materials

The steel for Anvil Forged Carbon Steel Fittings consists of forging, bars, seamless pipe or tubes which conform to the requirements for melting process, chemical composition and mechanical properties of ASTM A105.

Design Basis

ASME B16.11 – Forged fittings, socket-weld and threaded

Dimensions

ASME B16.11, unless otherwise noted

Threads

ASME B1.20.1 NPT Threads

Forged Steel Fittings

In accordance with ASME standard B16.11 – “Forged Fittings, Socket-Welding and Threaded” this table shows the schedule of pipe corresponding to each class of fitting for rating purposes.

Class	Pressure Ratings	
	Schedule	
	N.P.T.	S.W.
2000	80	–
3000	160	80
6000	XXS/XXH	160

ASME B16.11 provides that the maximum allowable pressure of a fitting be computed in accordance with the applicable piping code or regulation for straight seamless pipe or for material of equivalent composition and mechanical properties to the fitting. Any corrosion or mechanical allowances and any reduction in allowable stress due to temperature or other service conditions must be applied to the pipe and fitting alike.


Standards and Specifications

	Dimensions	Material	Thread	Pressure Rating
Forged Steel Threaded Fittings				
Class 2000, 3000, 6000	ASME B16.11	ASTM A105, ASTM A182, ASTM A350	ASME B1.20.1	ASME B16.11

Reducing Fittings

Reducing elbows, tees and crosses are available in both threaded and socket-welding.

On reducing tees and crosses give the size of the largest run opening; then give the opposite opening. On a tee give the branch size last. On a cross give the largest side outlet third and the opposite opening last.

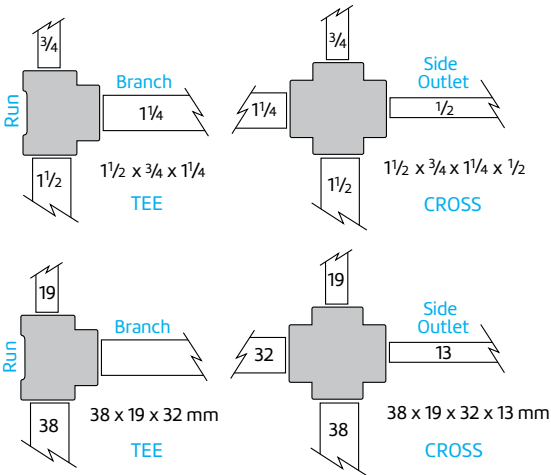

asc-es.com

Building connections that last™