


## Class 300 (XS/XH)

# FIG. 3170

## 90° Street Elbow

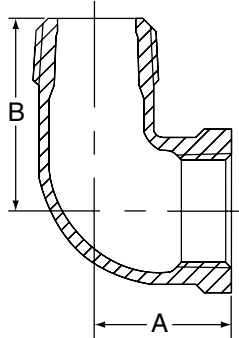

For Listings/Approval Details and Limitations, visit our website at [www.anvilintl.com](http://www.anvilintl.com) or contact an Anvil® Sales Representative.

### FIGURE 3170 - 90° STREET ELBOW

Nominal Size	Dimensions		Approx. Wt. Each
	A	B	
<i>In. (mm)</i>	<i>In. (mm)</i>	<i>In. (mm)</i>	<i>Lbs. (kg)</i>
1/4	0.94	1.44	0.17
8	23.88	36.58	0.08
3/8	1.06	1.63	0.26
10	26.92	41.40	0.12
1/2	1.25	2.00	0.40
15	31.75	50.80	0.18
3/4	1.44	2.19	0.68
20	36.58	55.63	0.31
1	1.63	2.56	1.10
25	41.40	65.02	0.50
1 1/4	1.94	2.88	1.60
32	49.28	73.15	0.73
1 1/2	2.13	3.13	2.20
40	54.10	79.50	1.00
2	2.50	3.69	3.60
50	63.50	93.73	1.63
3	3.38	5.13	9.60
80	85.85	130.30	4.35

### MATERIAL SPECIFICATIONS

Dimensions: Fittings: ASME B16.3  
 Unions: ASME B16.39  
 Bushings/Plugs: ASME B16.14

Material: ASTM A-197

Finish: Black or Hot Dip Galvanized per ASTM A153 Class A

Threads: NPT per ASME B1.20.1

Pressure Ratings: Fittings: ASME B16.3  
 Unions: ASME B16.39  
 Bushings/Plugs: ASME B16.14

Pressure Testing: All malleable iron fittings are tested for through wall porosity using an air under water process.

Agency Approvals: All malleable iron fittings and unions are UL/ULC Listed and FM Approved.

### PROJECT INFORMATION

### APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	